


# Chemours Preliminary Data, August 2017

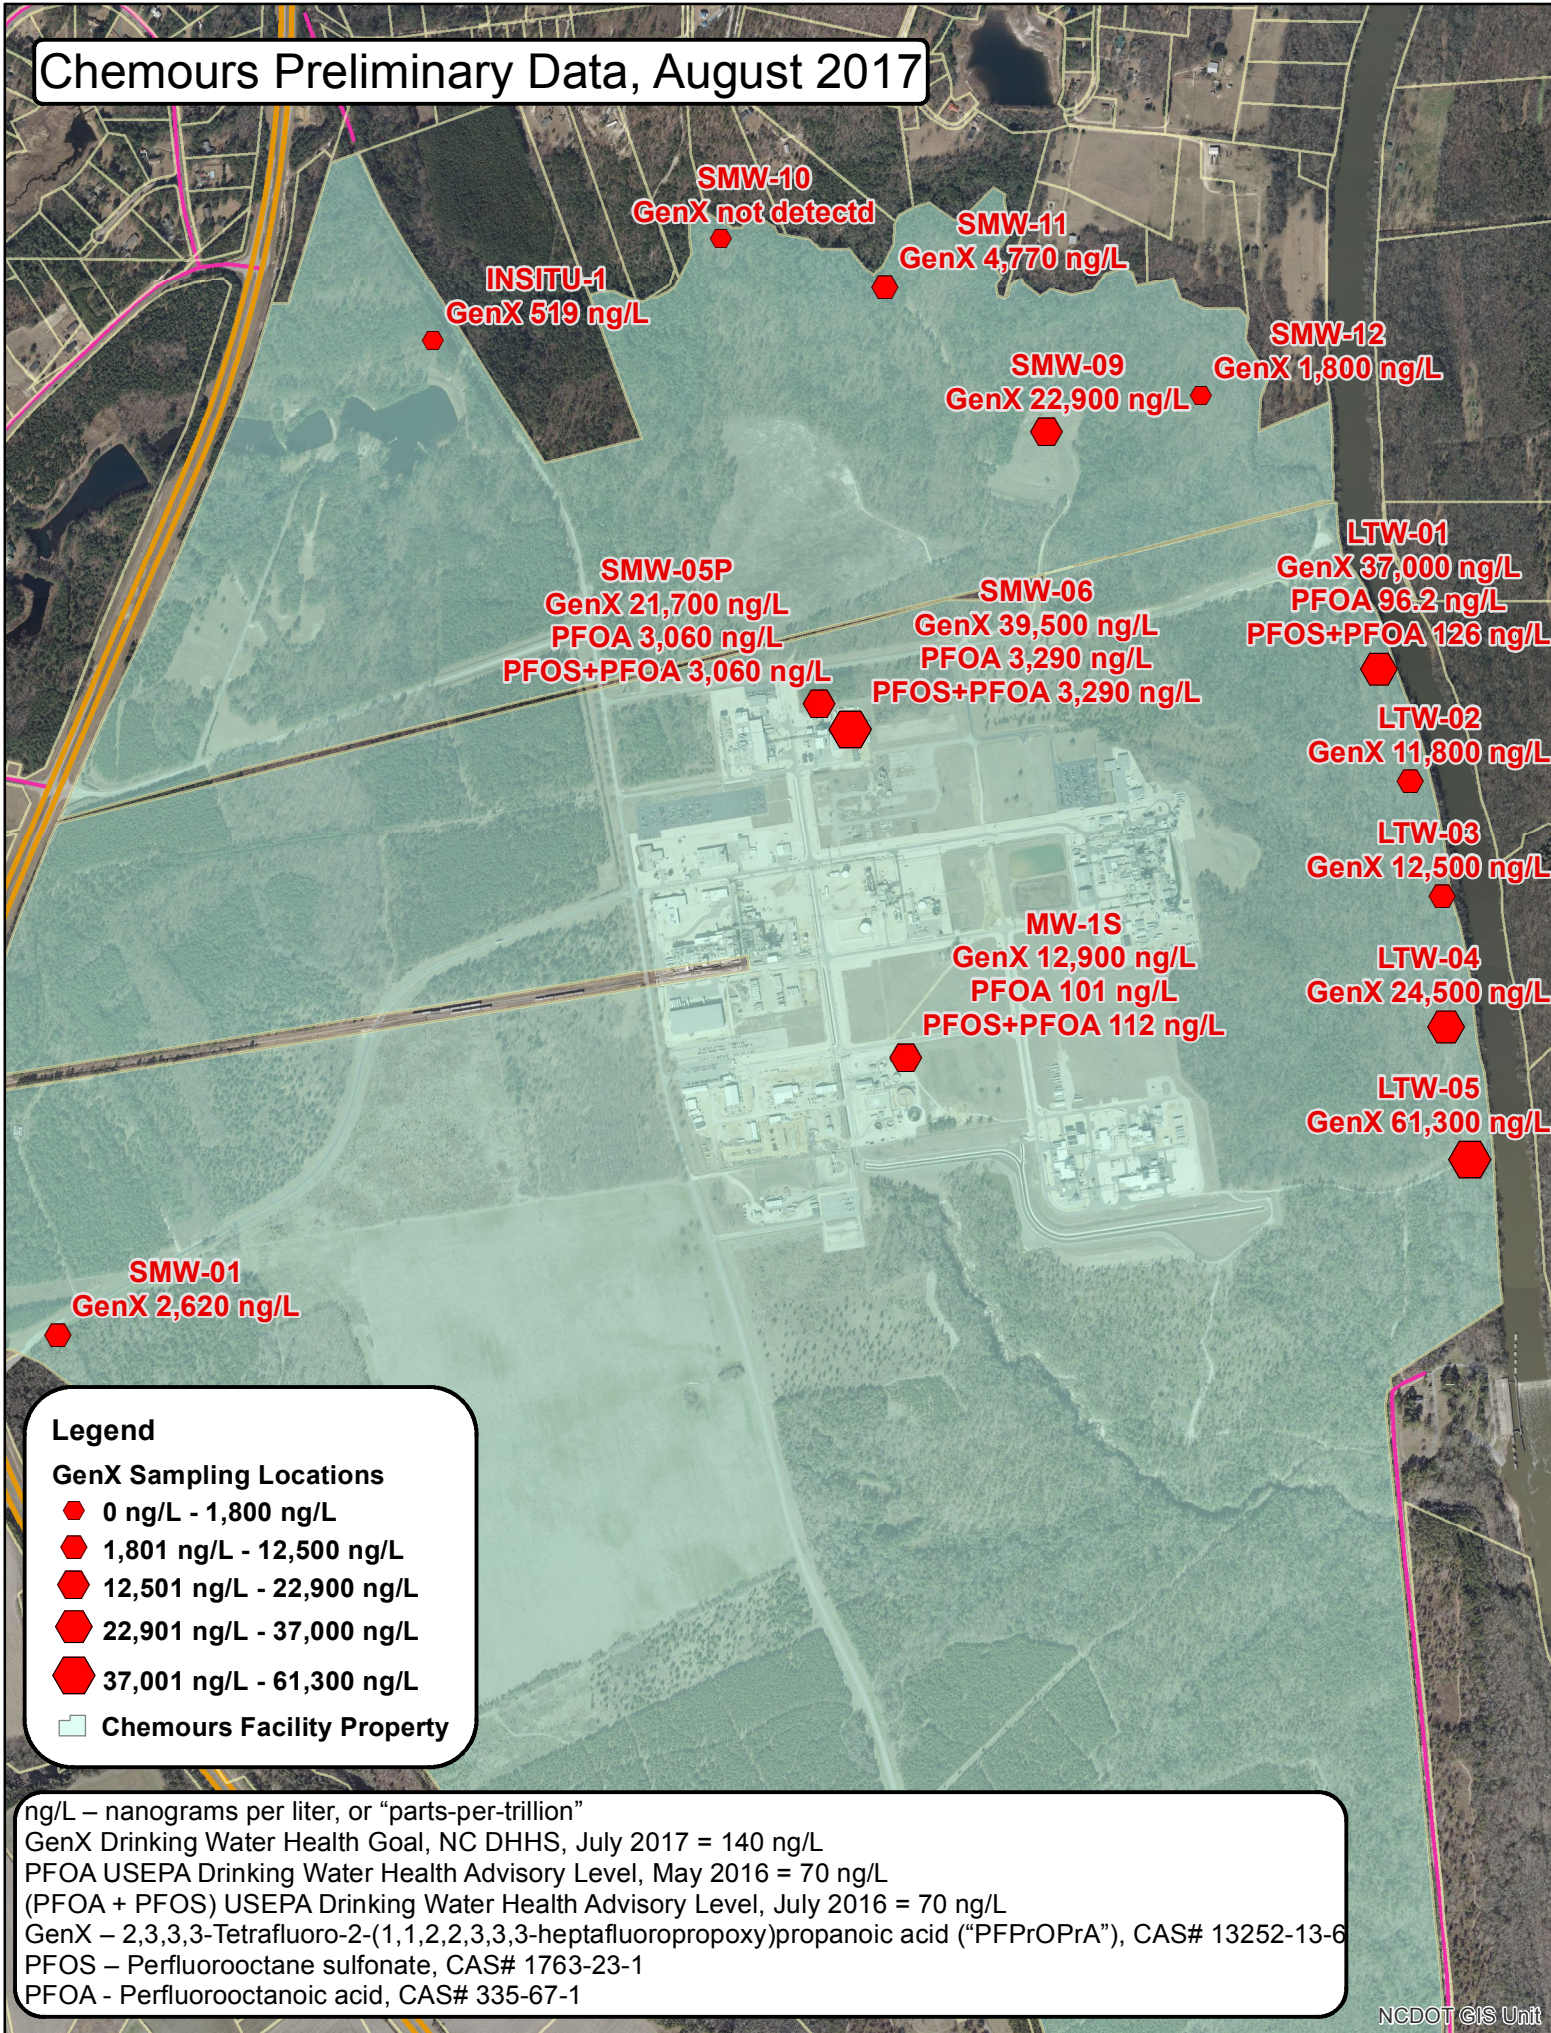

## Legend

### GenX Sampling Locations

- 0 ng/L - 1,800 ng/L
- 1,801 ng/L - 12,500 ng/L
- 12,501 ng/L - 22,900 ng/L
- 22,901 ng/L - 37,000 ng/L
- 37,001 ng/L - 61,300 ng/L

□ Chemours Facility Property

ng/L – nanograms per liter, or “parts-per-trillion”

GenX Drinking Water Health Goal, NC DHHS, July 2017 = 140 ng/L

PFOA USEPA Drinking Water Health Advisory Level, May 2016 = 70 ng/L

(PFOA + PFOS) USEPA Drinking Water Health Advisory Level, July 2016 = 70 ng/L

GenX – 2,3,3,3-Tetrafluoro-2-(1,1,2,2,3,3,3-heptafluoropropoxy)propanoic acid (“PFPrOPrA”), CAS# 13252-13-6

PFOS – Perfluorooctane sulfonate, CAS# 1763-23-1

PFOA - Perfluorooctanoic acid, CAS# 335-67-1