



Harry K. Sideris  
Senior Vice President  
Environmental, Health & Safety  
526 S. Church Street  
Mail Code: EC3XP  
Charlotte, NC 28202  
(704) 382-4303

April 28, 2016

Jeffrey O. Poupart  
Water Quality Permitting Section Chief  
Division of Water Resources  
Department of Environmental Quality  
State of North Carolina  
1617 Mail Service Center  
Raleigh, NC 27699-1617

Subject: March 2, 2016 Insufficiency of Discharge Assessment Plans – Duke Energy Carolinas, LLC and Duke Energy Progress, LLC

Dear Mr. Poupart:

This responds to your letter of March 2, 2016 to Duke Energy Carolinas, LLC and Duke Energy Progress, LLC on March 2, 2016 regarding Duke Energy's proposed Discharge Assessment Plans.

With regard to your letter describing changes in *Section 3.2.2 Observation and Sampling*:

- *The discussion must include a statement noting that jurisdictional determinations regarding the extent of waters of the United States and their relationship with identified seeps at the subject facilities will be obtained from the United States Army Corps of Engineers (USA COE).*

Duke Energy does not yet have jurisdictional determinations from the US Army Corps of Engineers for the relevant areas at all of the twelve sites mentioned in your letter. We submitted applications for jurisdictional determinations in September, October, and November 2015 and have since worked with the Corps of Engineers to schedule site visits and provide draft plats for approval. Nonetheless, the timing of the approved jurisdictional determinations is up to the Corps and outside of Duke's control. To date, out of these twelve sites, only Buck has an approved jurisdictional determination, but we do not yet have the signed plats.

We will submit the maps you have requested for each site on a rolling basis, within a reasonable period after the jurisdictional determinations are complete. In order to address the changes described in your March 2, 2016 letter, we have added the following text at the start of Section 3.2.2.

*Jurisdictional determinations regarding the extent of waters of the United States and their relationship with identified seeps at the subject facilities will be obtained from the United States Army Corps of Engineers (USA COE). Until jurisdictional determinations are finalized by USA COE, preliminary information will be used to evaluate the seeps as described in the section below.*

The second change in Section 3.2.2 described in your letter is as follows.

- *The schedule for water quality sampling of the seeps and related jurisdictional waters must be more frequent than the semi-annual basis stated in the proposed DAPs. DWR recommends a monthly monitoring schedule, consistent with the conditions described in the DAPs' general assessment requirements, for all identified seeps that will continue for twelve ( 12) months. After that time, monitoring may be reduced to a semi-annual basis until such monitoring becomes a requirement of the NPDES permit.*

We do not believe sampling monthly as part of a revised Discharge Assessment Plan is warranted. For the larger receiving waters, data is available from sampling associated with NPDES permits that demonstrates the lack of impact on the larger surface waters of the state. In addition, we are conducting weekly observations of all AOWs on a dam or dike slope, sampling any new seeps, and providing the analytical results to DEQ. We recommend the sampling frequency under the DAPs remain at twice/year with the weekly inspections of dam slopes for any new seeps with data provided to DEQ. We recommend that we collectively focus our resources on the completion of all of the NPDES Wastewater Permits for the Duke Energy sites and implement appropriate sampling frequency for each of the permitted seeps in that document .

However, in order to address the changes described in your March 2, 2016 letter, we have added the following text in Section 3.2.2.


*In addition to sampling conducted with the semi-annual assessments, additional seep sampling will be conducted at locations and at a frequency as determined through discussions with NC DEQ personnel.*

We would like to work with DEQ to achieve alignment of the various (present and future) documents involving required seep activities including:

- Discharge Assessment Plans
- Discharge Identification Plans
- NPDES Wastewater Permits
- EPA requirements
- Any future legal agreements with either DEQ or EPA

Duke Energy is committed to providing the Department with additional information to facilitate the issuance of new NPDES Wastewater permits. The issues are complex and require special consideration, as illustrated by the time elapsed since the permit applications were submitted. We look forward to working with you further to resolve the issues identified here on a mutually acceptable schedule.

Sincerely,



Harry Sideris  
Senior Vice President  
Environmental, Health and Safety

Allen Steam Station Ash Basin

# Topographic Map and Discharge Assessment Plan

NPDES Permit NC0004979

April 29, 2016





# Contents

	<u>Page</u>
Contents .....	i
Figures and Tables .....	ii
Section 1 - Introduction .....	1
Section 2 - Site Background.....	3
2.1 Plant Description.....	3
2.2 Ash Basin Description.....	3
2.3 Site Geologic/Soil Framework.....	3
2.4 Topographic Map and Identification of Discharges.....	4
2.4.1 Engineered Drainage System for Earthen Dam.....	5
2.4.2 Non-Engineered Seep Identification .....	5
Section 3 - Discharge Assessment Plan.....	6
3.1 Purpose of Assessment .....	6
3.2 Assessment Procedure.....	6
3.2.1 General Assessment Requirements .....	6
3.2.2 Observation and Sampling .....	7
3.2.3 Evaluation .....	9
3.2.4 Assessment Reporting .....	9
Section 4 - References.....	10



# Figures and Tables

Figure 1 – Site Location Map

Figure 2 – Topographic Map

Table 1 – Seep and Associated Discharge Locations and Descriptions

Table 2 – Laboratory Analytical Methods

Table 3 – Allen Steam Station – Example of Surface Water/Seep Monitoring Flow and Analysis Results Table



## Section 1 - Introduction

The purpose of this document is to address the requirements of North Carolina General Statute (GS)130A-309.210(a) *topographic map* and (b) *Assessment of Discharges from Coal Combustion Residuals Surface Impoundments to the Surface Waters of the State*, as modified by North Carolina Senate Bill 729, for the Allen Steam Station ash basin operated under National Pollutant Discharge Elimination System (NPDES) Permit NC0004979.

The following requirements are contained in General Statute (GS) 130A-309.210(a):

- (1) *The owner of a coal combustion residuals surface impoundment shall identify all discharges from the impoundment as provided in this subsection. The requirements for identifying all discharges from an impoundment set out in this subsection are in addition to any other requirements for identifying discharges applicable to the owners of coal combustion residuals surface impoundments.*
- (2) *No later than December 31, 2014, the owner of a coal combustion residuals surface impoundment shall submit a topographic map that identifies the location of all (i) outfalls from engineered channels designed or improved for the purpose of collecting water from the toe of the impoundment and (ii) seeps and weeps discharging from the impoundment that are not captured by engineered channels designed or improved for the purpose of collecting water from the toe of the impoundment to the Department. The topographic map shall comply with all of the following:*
  - a. *Be at a scale as required by the Department.*
  - b. *Specify the latitude and longitude of each toe drain outfall, seep, and weep.*
  - c. *Specify whether the discharge from each toe drain outfall, seep, and weep is continuous or intermittent.*
  - d. *Provide an average flow measurement of the discharge from each toe drain outfall, seep, and weep including a description of the method used to measure average flow.*
  - e. *Specify whether the discharge from each toe drain outfall, seep, and weep identified reaches the surface waters of the State. If the discharge from a toe drain outfall, seep, or weep reaches the surface waters of the State, the map shall specify the latitude and longitude of where the discharge reaches the surface waters of the State.*
  - f. *Include any other information related to the topographic map required by the Department.*

The following requirements are contained in General Statute (GS) 130A-309.210(b):

- b) *Assessment of Discharges from Coal Combustion Residuals Surface Impoundments to the Surface Waters of the State. The owner of a coal combustion residuals surface impoundment shall conduct an assessment of discharges from the coal combustion*

*residuals surface impoundment to the surface waters of the State as provided in this subsection. The requirements for assessment of discharges from the coal combustion residuals surface impoundment to the surface waters of the State set out in this subsection are in addition to any other requirements for the assessment of discharges from coal combustion residuals surface impoundments to surface waters of the State applicable to the owners of coal combustion residuals surface impoundments.*

- (1) No later than December 31, 2014, the owner of a coal combustion residuals surface impoundment shall submit a proposed Discharge Assessment Plan to the Department. The Discharge Assessment Plan shall include information sufficient to allow the Department to determine whether any discharge, including a discharge from a toe drain outfall, seep, or weep, has reached the surface waters of the State and has caused a violation of surface water quality standards. The Discharge Assessment Plan shall include, at a minimum, all of the following:
  - a. Upstream and downstream sampling locations within all channels that could potentially carry a discharge.*
  - b. A description of the surface water quality analyses that will be performed.*
  - c. A sampling schedule, including frequency and duration of sampling activities.*
  - d. Reporting requirements.*
  - e. Any other information related to the identification of new discharges required by the Department.**
- (2) The Department shall approve the Discharge Assessment Plan if it determines that the Plan complies with the requirements of this subsection and will be sufficient to protect public health, safety, and welfare; the environment; and natural resources.*
- (3) No later than 30 days from the approval of the Discharge Assessment Plan, the owner shall begin implementation of the Plan in accordance with the Plan's schedule.*

The North Carolina Senate Bill 729 establishes the submittal date of this topographic map and Discharge Assessment Plan no later than December 31, 2014.

The topographic map, developed to satisfy the requirements of GS130A-309.210(a), was utilized as the basis for developing the assessment procedures presented in this plan, required by GS130A-309.210(b).

## Section 2 - Site Background

### 2.1 Plant Description

Allen Steam Station is a five-unit, coal-fired, electric generating plant with a capacity of 1,140 megawatts located on the west bank of the Catawba River on Lake Wylie in Belmont, Gaston County, North Carolina. The site is located east of South Point Road (NC 273) and the surrounding area generally consists of residential properties, undeveloped land, and Lake Wylie (Figure 1).

### 2.2 Ash Basin Description

Allen Steam Station's ash basin consists of an active ash basin and an inactive ash basin. The active ash basin was commissioned in 1973 and is currently in operation<sup>1</sup>. The inactive ash basin is located to the north of the active ash basin and is not in operation. A large portion of the area on top of the inactive ash basin is permitted as an industrial landfill by the NC DEQ Division of Waste Management (Permit No. 3612). The area contained within the ash basin waste boundary is approximately 322 acres in area.

There are two earthen dikes impounding the active ash basin: the East Dike, located along the west bank of Lake Wylie, and the North Dike, separating the active and inactive ash basins. The surface area of the active ash basin is approximately 169 acres (Duke Energy, 2009) with an operating pond elevation of approximately 633.5 feet. The full pond elevation of Lake Wylie is approximately 568.7 feet.

The ash basin is operated as an integral part of the station's wastewater treatment system, which receives flows from the ash removal system, coal pile runoff, landfill leachate, flue-gas desulfurization (FGD) wastewater, the station yard drain sump, and stormwater flows. Due to variability in station operations and weather, the inflows to the ash basin are highly variable. The inflows from the ash removal system and other plant discharges are discharged through sluice lines to the ash basin. Prior to 2009, all of the fly ash produced was sluiced to the ash basin. Since 2009, fly ash has been dry-handled and is infrequently sluiced to the ash basin. All of the bottom ash produced by the station is sluiced to the ash basin.

Effluent from the ash basin is discharged from the discharge tower via a 42-inch-diameter reinforced concrete pipe to Lake Wylie. The water surface elevation in the ash basin is controlled by the use of stoplogs in the discharge tower.

### 2.3 Site Geologic/Soil Framework

Allen Steam Station is located in the Charlotte terrane within the Piedmont province. The Piedmont province is bounded to the east and southeast by the Atlantic Coastal Plain and to the west by the escarpment of the Blue Ridge Mountains, covering a distance of 150 to 225 miles (LeGrand 2004).

---

<sup>1</sup> Information obtained from Duke Energy Carolinas, LLC CERCLA 104(e) Request for Information to US Environmental Protection Agency, Allen Steam Station, dated March 26, 2009.



The topography of the Piedmont region is characterized by low, rounded hills and long, rolling, northeast-southwest trending ridges (Heath, 1984). Stream valley to ridge relief in most areas ranges from 75 to 200 feet. Along the Coastal Plain boundary, the Piedmont region rises from an elevation of 300 feet above mean sea level to the base of the Blue Ridge Mountains at an elevation of 1,500 feet (LeGrand 2004).

Charlotte terrane bedrock consists primarily of igneous and metamorphic bedrock. The fractured bedrock is overlain by a mantle of unconsolidated material known as regolith. The regolith includes, where present, the soil zone (a zone of weathered, decomposed bedrock known as saprolite) and, where present, alluvium. Saprolite, the product of chemical and mechanical weathering of the underlying bedrock, is typically composed of clay and coarser granular material up to boulder size and may reflect the texture of the rock from which it was formed. The weathering product of granitic rocks are quartz rich and sandy textured; whereas, rocks poor in quartz and rich in feldspar and other soluble minerals form a more clayey saprolite. The regolith serves as the principal storage reservoir for the underlying bedrock (LeGrand 2004).

A transition zone may occur at the base of the regolith between the soil-saprolite and the unweathered bedrock. This transition zone of partially weathered rock is a zone of relatively high permeability compared to the overlying soil-saprolite and the underlying bedrock (LeGrand 2004).

Groundwater flow paths in the Piedmont are almost invariably restricted to the zone underlying the topographic slope extending from a topographic divide to an adjacent stream. LeGrand describes this as the local slope aquifer system. Under natural conditions, the general direction of groundwater flow can be approximated from the surface topography (LeGrand 2004).

Groundwater recharge in the Piedmont is derived entirely from infiltration of local precipitation. Groundwater recharge occurs in areas of higher topography (i.e., hilltops) and groundwater discharge occurs in lowland areas bordering surface water bodies, marshes, and floodplains (LeGrand 2004).

Allen's ash basin is situated between the steam station to the north and surface water divides to the west (along South Point Road) and south (along Reese Wilson Road), which both drop in elevation to the east toward Lake Wylie. The surface water divide along South Point Road likely functions as a groundwater divide. The topography at the site generally slopes downward from that divide toward Lake Wylie. The entire Allen site is approximately 1,009 acres in area.

## **2.4 Topographic Map and Identification of Discharges**

A topographic map is presented in Figure 2 to meet the requirements of GS 130A-309.210(a) in the identification of outfalls from engineered channels, as well as seeps and weeps.

Seepage is the movement of wastewater from the ash basin through the ash basin embankment, the embankment foundation, the embankment abutments, basin rim, through residual material in areas adjacent to the ash basin. A seep is defined in this document as an

expression of seepage at the ground surface. A weep is understood to have the same meaning as a seep.

Indicators of seepage include areas where water is observed on the ground surface and/or where vegetation suggests the presence of seepage. Seepage can emerge anywhere on the downstream face, beyond the toe, or on the downstream abutments at elevations below normal pool. Seepage may vary in appearance from a "soft," wet area to a flowing "spring." Seepage may show up first as only an area where the vegetation is lush and darker green than surrounding vegetation. Cattails, reeds, mosses, and other marsh vegetation often become established in a seepage area. However, in many instances, indicators of seeps do not necessarily indicate the presence of seeps. Areas of apparent iron staining and/or excess iron bacteria may also indicate the presence of a seep.

Locations of seepage at the ground surface adjacent to the ash basin have been identified and are shown in Figure 2. These areas include the earthen embankments which impound the ash basin as well as adjacent areas where water from the ash basin may have infiltrated into the underlying residual materials and expressed as seepage.

#### **2.4.1 Engineered Drainage System for Earthen Dam**

Earth dams are subject to seepage through the embankment, foundation, and abutments. Seepage control is necessary to prevent excessive uplift pressures, instability of the downstream slope, piping through the embankment and/or foundation, and erosion of material by migration into open joints in the foundation and abutments. The control of seepage is performed by the use of engineered drains such as blanket drains, trench drains, and/or toe drains. In certain cases, horizontal pipes may be installed into the embankment to collect and control seepage. It is standard engineering practice to collect the seepage and convey seepage away from the dam.

The Allen ash basin dam (GASTO-016) consists of an embankment oriented approximately east-to-west, referred to as the north dike, and an embankment oriented approximately north-to-south, along the Catawba River, referred to as the east dike. There are no drainage features, or outfalls, associated with the Allen ash basin dam to be shown as required by GS 130A-309.210(a)(2)(i).

#### **2.4.2 Non-Engineered Seep Identification**

Topographic maps of the site were reviewed to identify regions of the site where there was a potential for ash-basin-related seepage to be present. These regions were determined by comparing ash basin full pond elevations to adjacent topography with ground surface elevations lower than the ash basin full pond elevation. HDR staff performed site observations within these identified areas as part of NPDES inspections during the reapplication process during August and September 2014 and documented locations where seepage was apparent at the time of the site visit. These seeps are identified as required by GS 130A-309.210(a)(2)(ii) on Figure 2.

# Section 3 - Discharge Assessment Plan

## 3.1 Purpose of Assessment

The purpose of the assessment is to determine whether existing, known discharges from toe drain outfalls, seeps, and weeps associated with the coal combustion residuals surface impoundment (ash basin) have reached the surface waters of the State and have caused a violation of surface water quality standards as required by North Carolina General Statute 130A-309.210(b).

Figure 2 and Table 1 present the background and downstream sampling locations to be considered as part of this Discharge Assessment Plan (DAP). These locations may be assessed by comparing surface water sampling analytical results of the associated background location with the corresponding downstream location. For discharges located at the toe of a dam, an upstream location within the channel may not have been possible to isolate for comparison given the proximity to the ash basin, which would have the same chemical composition as the discharge itself. As such, the upstream location was established upstream of the ash basin and is considered “background.” For discharges located a distance from the ash basin, an identified upstream or “background” location for sampling may be compared to the downstream portion of the discharge channel. The background and downstream sampling locations are shown on Figure 2 with “B” and “D” identifiers, respectively, and the corresponding seep locations associated with the sampling locations are indicated on Table 1.

## 3.2 Assessment Procedure

The assessment procedure associated with the Allen ash basin is provided within this section. In addition to the specific requirements for the assessment, Section 3.2 also provides the general requirements, the frequency of assessment, documentation requirements, and a description of the surface water quality analyses that will be performed.

### 3.2.1 General Assessment Requirements

Assessments are to be performed in three phases as follows:

- Observation and Sampling (assessment site visit)
- Evaluation
- Assessment Reporting

The assessment site visit shall be performed when the background and downstream locations are accessible and not influenced by weather events. Locations on or adjacent to the ash basin embankments should be performed within two months after mowing, if possible. In addition, the assessment site visit should not be performed if the following precipitation amounts have occurred in the respective time period preceding the planned assessment site visit:

- Precipitation of 0.1 inches or greater within 72 hours or
- Precipitation of 0.5 inches or greater within 96 hours

The assessments shall be performed under the direction of a qualified Professional Engineer or Professional Geologist on a semi-annual basis during two nonadjacent quarters. The date of the



initial assessment site visit shall be selected no later than 30 days from the approval of the Discharge Assessment Plan and should fall within one of the semi-annual timeframes. Additional seep locations that may have been identified and documented in an Identification of New Discharge report(s) shall be reviewed prior to performing an assessment site visit, if available.

### **3.2.2 Observation and Sampling**

Jurisdictional determinations regarding the extent of waters of the United States and their relationship with identified seeps at the subject facilities will be obtained from the United States Army Corps of Engineers (USACE). Until jurisdictional determinations are finalized by USACE, preliminary information will be used to evaluate the seeps as described in the section below.

The initial assessment site visit should be performed to document baseline conditions of the discharge channel including location, extent (i.e., dimensions of affected area), and flow of each discharge. Discharge channel background and downstream locations should be verified using a Global Positioning System (GPS) device. Photographs should be taken from vantage points that can be replicated during subsequent semi-annual assessments.

Initial and subsequent assessment site visits shall document a minimum of the following to respond to the requirements in 130A-309.210.1(b):

- Record the most recent ash basin water surface elevation and compare to the seep and outfall and associated discharge location surface water elevations.
- For each discharge channel, the observer shall note the following as applicable on the day of the assessment site visit:
  - Is the discharge channel flowing at the time of the assessment site visit?
  - Does the discharge channel visibly flow into a Water of the U.S. at the time of the assessment site visit?
  - How far away is the nearest Water of the U.S.?
  - Document evidence that flow has or could reach a Water of the U.S. (e.g., description of flow, including extent and/or direction) and describe the observed condition. Evidence that flow could or has reached a Water of the U.S. may be indicated by an inspection of the adjacent and downstream topographic drainage features.
  - Observe and document the condition of the discharge channel and outfall of the engineered channel or seep location with photographs. Photographs are to be taken from similar direction and scale as photographs taken during the initial assessment site visit.
- Record flow rate within the discharge channel, if measureable, using the following methods:

- Timed-volumetric method: Collect a volume of water from the discharge of the PVC pipe directly into an appropriately sized container. Measure volumes (in mL) in the field utilizing a graduated container. Record the amount of time (in seconds) needed to collect the volume of water and calculate the flows (in MGD) for the timed volume.
- A V-notch weir apparatus will be installed, if necessary, during the initial assessment site visit to impound seepage at locations with a defined channel. Once the impounded seep reaches equilibrium discharge, flows will be measured using the timed-volumetric method described above.
- Area-velocity method: Measure point velocities and water depth at a minimum of 20 stations along a transect setup perpendicular to the direction of flow using a Swoffer® 3000 flow meter mounted to a standard United States Geologic Survey (USGS) top-set wading rod. Utilize the average velocity and cross-sectional area of the wetted channel to calculate flows in MGD.
- Collect water quality samples using the following methods:
  - Collect background and downstream samples during a period with minimal preceding rainfall to minimize potential effects of stormwater runoff. Sampling procedures should prevent the entrainment of soils and sediment in water samples that can result in analytical results not being representative of the flow. Because Areas of Wetness (AOWs)/seeps often have poorly defined flow channels and minimal channel depth, conventional grab samples collected directly into laboratory containers or intermediate vessels is not possible without disturbance and entrainment of soils and sediments. Further, many AOWs are contiguous with low-lying areas subject to surface water runoff and resulting heavy sediment loading during storm events or are near surface waters subject to flooding such that representative samples of the AOW cannot be obtained. If the facility is unable to obtain an AOW sample due to the dry, low flow or high flow conditions preventing the facility from obtaining a representative sample, a “no flow” result or “excessive flow” will be recorded.
  - After collection, samples will be preserved and stored according to parameter-specific methods and delivered to the laboratory under proper Chain-of-Custody (COC) procedures.
  - Analytical parameters for analysis include: Fluoride, Arsenic, Cadmium, Copper, Chromium, Nickel, Lead, Selenium, and Mercury. This list includes all parameters previously identified for seep sampling at Duke Energy power plants for which relevant stream water quality standards are in place. (This list is responsive to the statutory requirement for the discharge assessment to allow determination whether discharges from toe drain outfalls, seeps, or weeps have reached surface waters and caused a violation of surface water quality standards.) Analyses shall be conducted by Duke Energy’s Huntersville Analytical Laboratory (NC Wastewater Certification #248) and Pace Analytical Laboratories (NC Wastewater Certification

# 12). Laboratory analytical methods used for each constituent are provided in Table 2.

- Seep In-situ measurements: In-situ field parameters (temperature and pH) shall be measured utilizing calibrated field meters either at the discharge of the seep directly, at the discharge of the flow measurement devices, or in the water pool created behind the device if sufficient water depth did not exist at the device discharge.
- Lake Wylie and Ash Basin Sample Collection Method: Water quality samples and in-situ measurements from Lake Wylie shall be collected at a location upstream (Lake Wylie-Upstream) and downstream (Lake Wylie-Downstream) of the ash basin (Figure 1). Additionally, water samples and in-situ measurements shall be collected from an in-process ash basin location such as near the Active Ash Basin discharge tower (Figure 2). The grab samples shall be collected from the river and basin's surface (0.3 m) directly into appropriate sample bottles.
- In addition to sampling conducted with the semi-annual assessments, additional seep sampling will be conducted at locations and at a frequency as determined through discussions with NC DEQ personnel.

### **3.2.3 Evaluation**

Evaluation of the data from the initial assessment site visit will establish baseline conditions and will serve as the basis for comparison for subsequent assessment site visit results. Evaluation of observations and sampling results shall include location, extent (i.e., dimensions of affected area), and flow of each discharge. The analytical results of the upstream and downstream locations shall be compared to the 15A NCAC 2B standards for surface water quality upon receipt to identify potential exceedances.

### **3.2.4 Assessment Reporting**

Each assessment site visit shall be documented by the individual performing the assessment, as described in Section 3.2.2 to meet the requirements in 130A-309.210.1(b). The report should contain site background, observation and sampling methodology, and a summary of the observations and descriptions of the discharge channels observed, changes in observations compared to previous assessment events, estimates of flows quantities, and photographs of discharges and outfalls of engineered channels designed or improved for collecting water from the impoundment. Photographs are to be numbered and captioned. The flow and analytical results shall be recorded and presented in tables similar to the examples provided as Tables 1 and 3. The analytical results shall be compared to the 15A NCAC 2B standards for surface water quality and exceedances highlighted. This information shall be compiled, reviewed, and submitted to NC DEQ within 90 days from the Observation and Sampling event.




## Section 4 - References

Duke Energy Carolinas, LLC. 2009. CERCLA 104(e) Request for Information to US Environmental Protection Agency, Allen Steam Station, dated March 26, 2009.

Heath, R.C. 1984. "Ground-water regions of the United States." U.S. Geological Survey Water-Supply Paper 2242, 78 p.


LeGrand, Harry, Sr. 2004. A Master Conceptual Model for Hydrogeological Site Characterization in the Piedmont and Mountain Region of North Carolina, North Carolina Department of Environment and Natural Resources.

North Carolina Department of Environment and Natural Resources . 2007. *Dam Operation, Maintenance, and Inspection Manual*, North Carolina Department of Environment and Natural Resources, Division of Land Resources, Land Quality Division, 1985 (Revised 2007).

A decorative graphic consisting of several colored rectangles. A large teal rectangle is on the left, with a grey rectangle above it and a dark grey rectangle below it. To the right of the teal rectangle is a light grey rectangle. The text 'FIGURES AND TABLES' is centered in the white space between the teal and light grey rectangles.

**FIGURES  
AND  
TABLES**




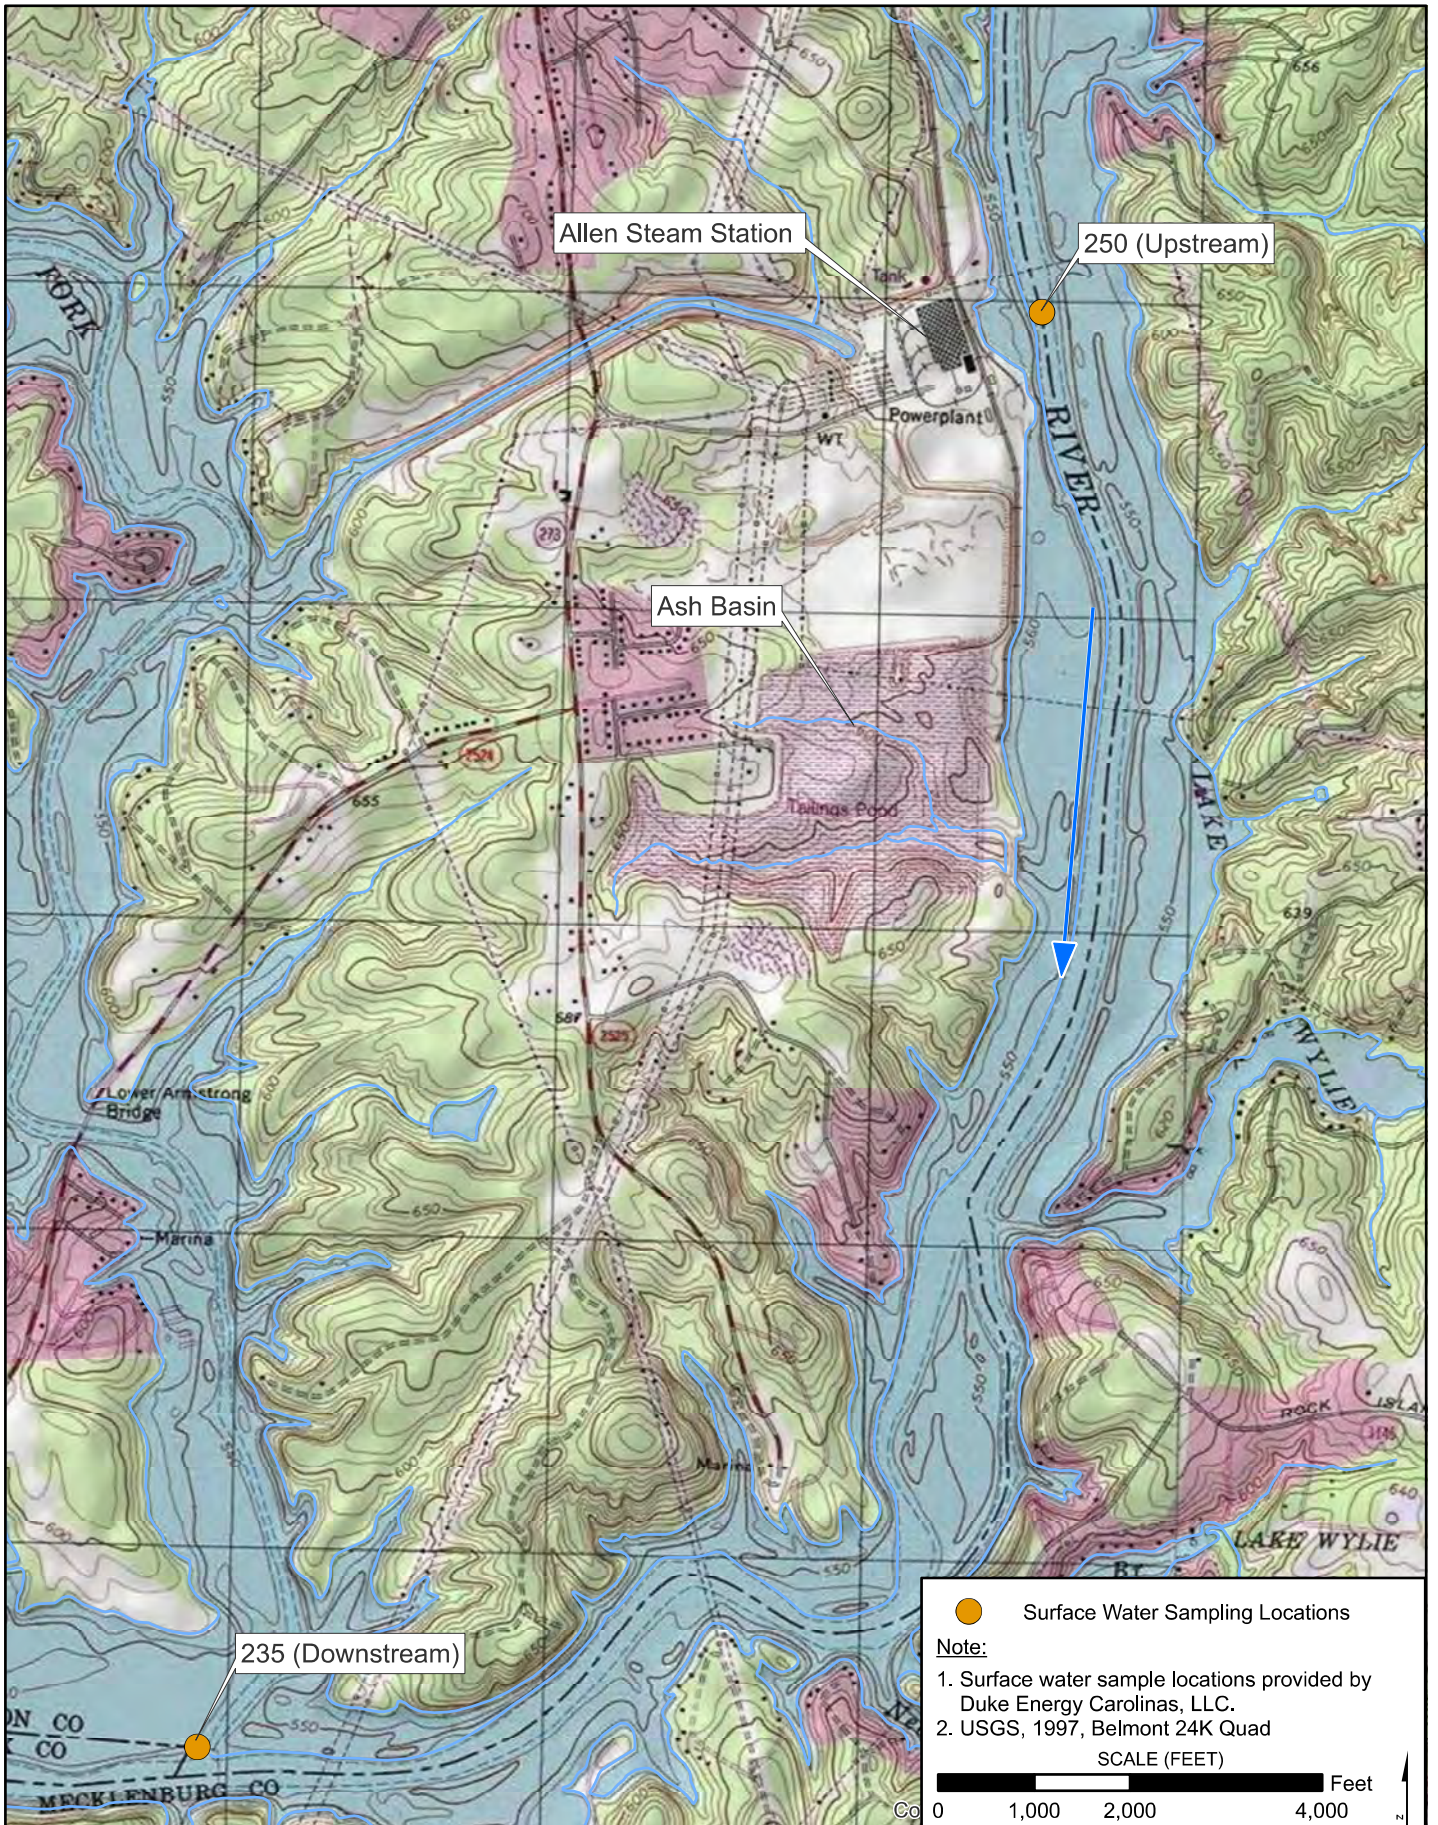

**SITE LOCATION MAP  
 ALLEN STEAM STATION  
 DUKE ENERGY CAROLINAS, LLC  
 GASTON COUNTY, NORTH CAROLINA**

**DATE**  
 October 1, 2014

**FIGURE**  
 1

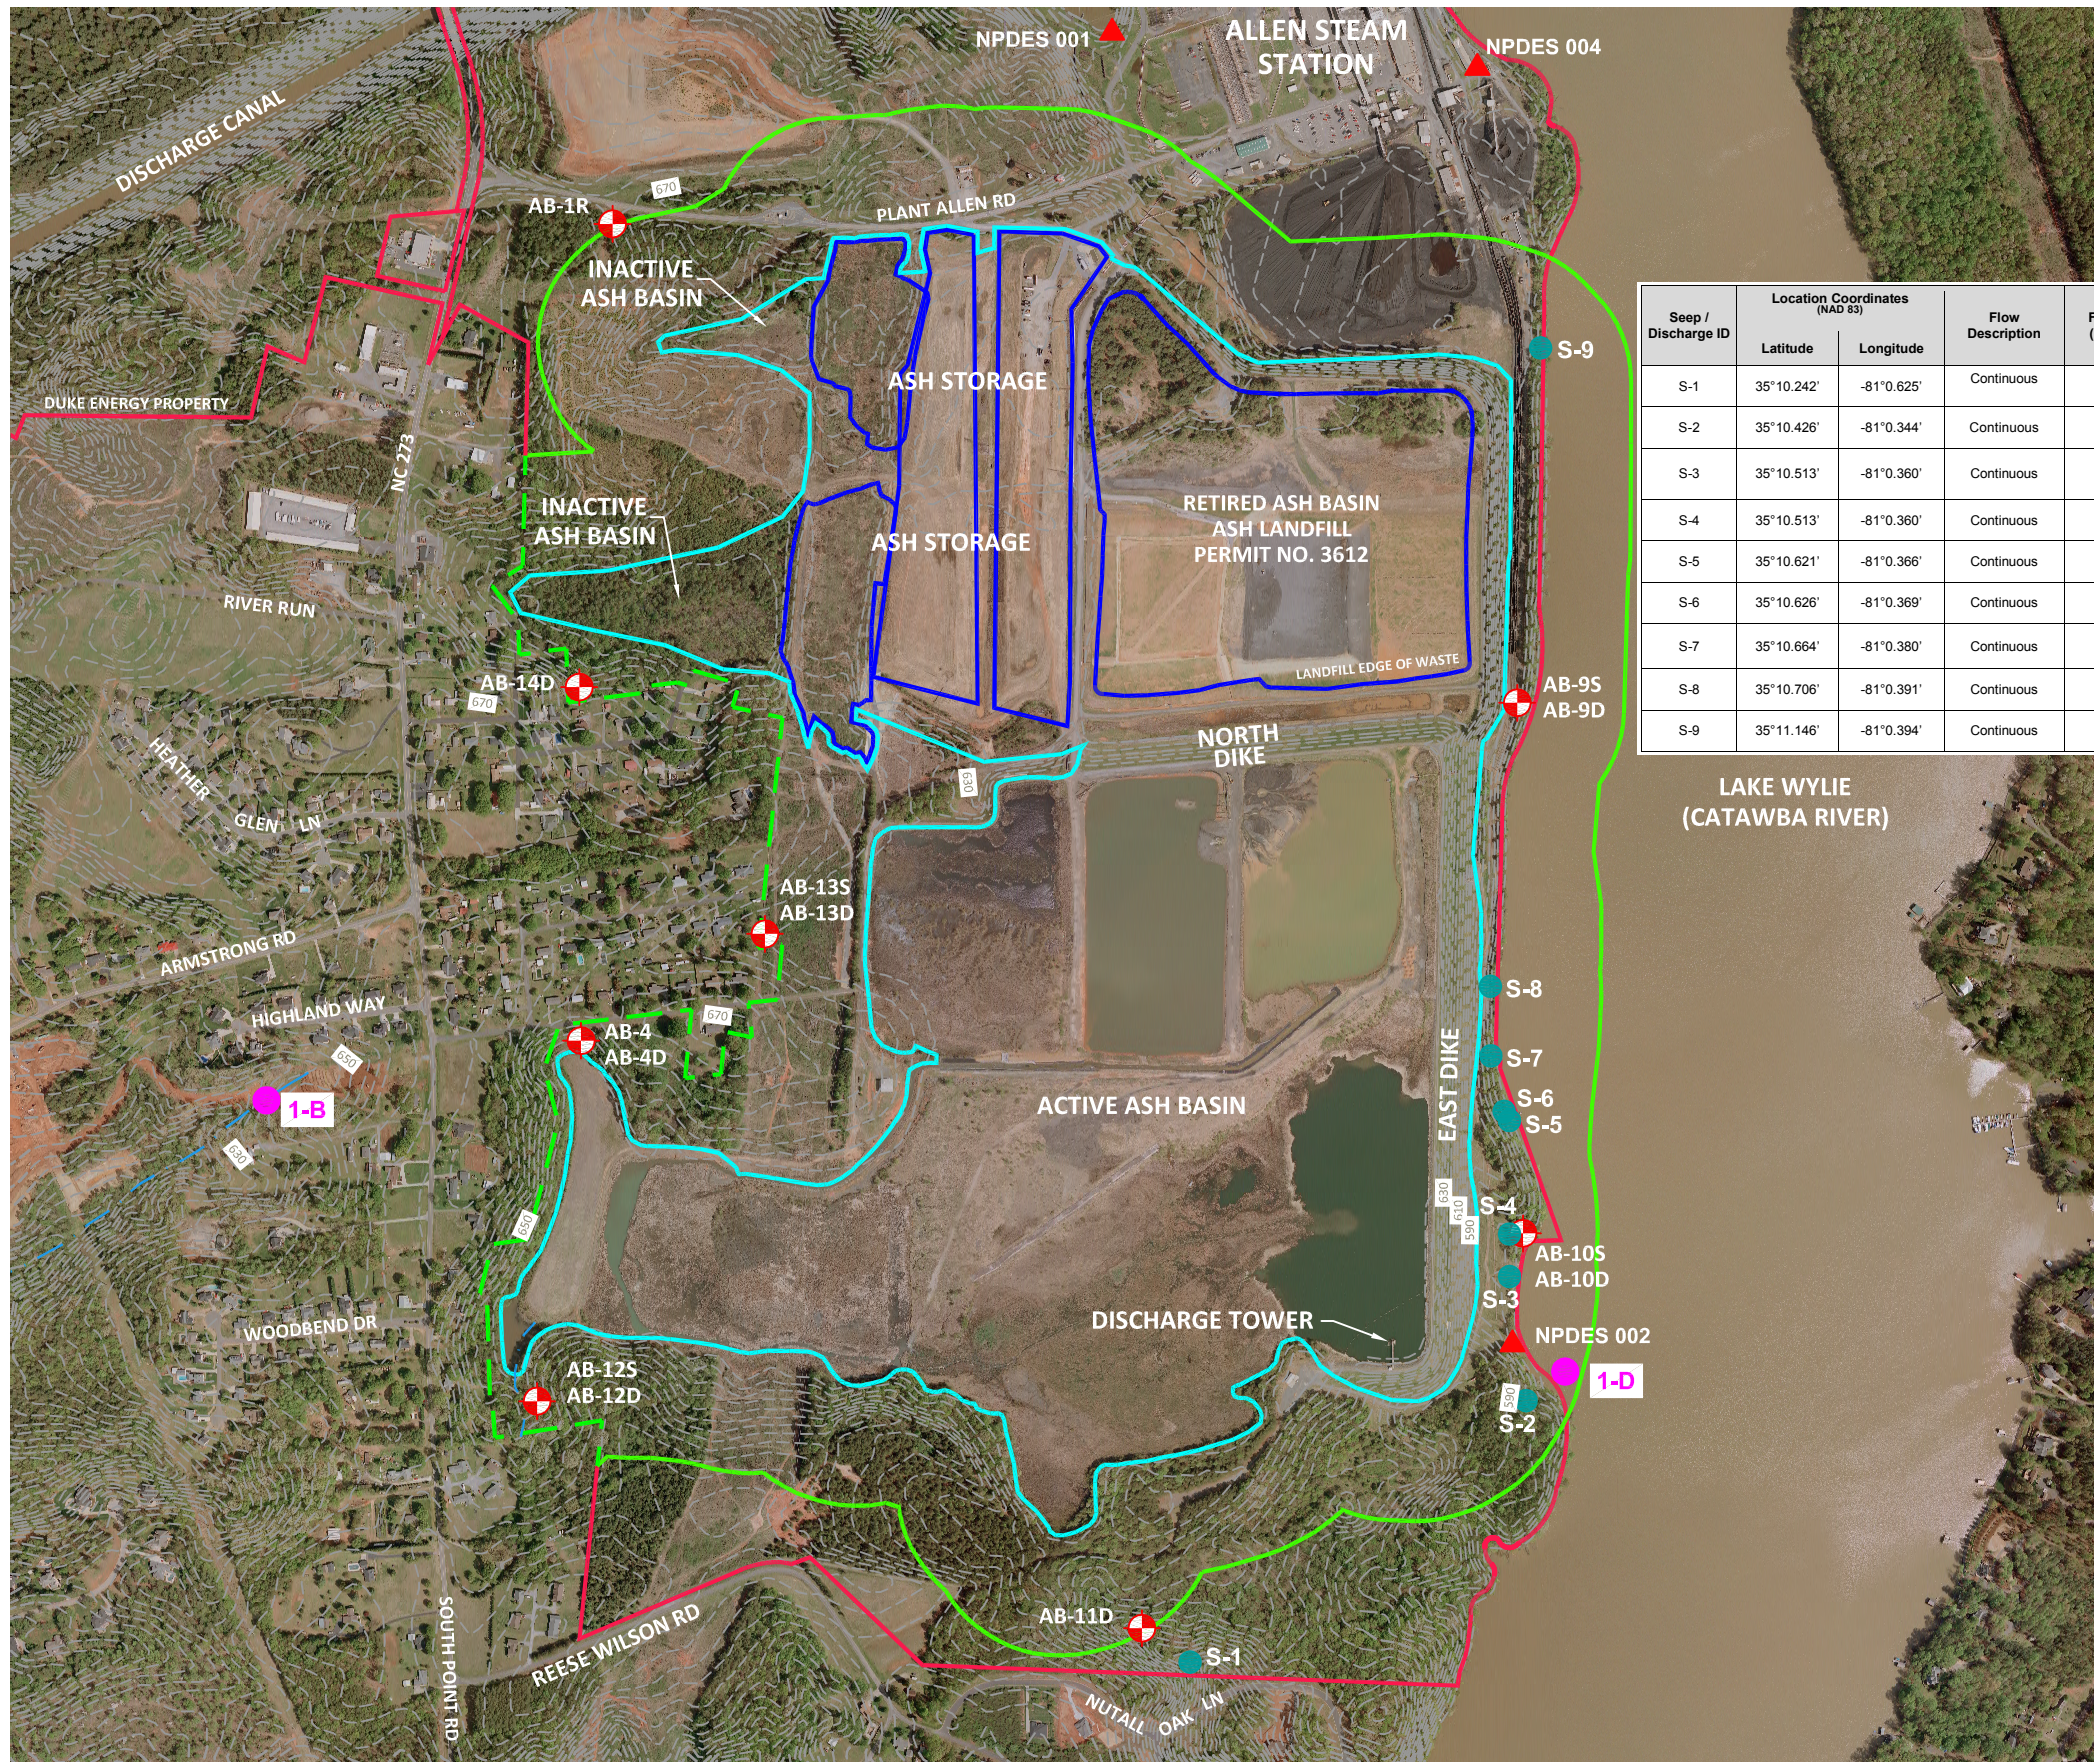


Seep / Discharge ID	Location Coordinates (NAD 83)		Flow Description	Flow Measurement (MGD) and Method	Background Sampling Locations	Discharge Location and Discharge Sampling Locations	Discharge Location Coordinates (NAD 83)	
	Latitude	Longitude					Latitude	Longitude
S-1	35°10.242'	-81°0.625'	Continuous	0.0004 timed-volumetric	1-B	Tributary towards Lake Wylie 1-D	35°10.451'	-81°0.325'
S-2	35°10.426'	-81°0.344'	Continuous	0.0025 timed-volumetric				
S-3	35°10.513'	-81°0.360'	Continuous	0.0083 timed-volumetric				
S-4	35°10.513'	-81°0.360'	Continuous	0.0008 timed-volumetric		Unconfined diffuse flow towards Lake Wylie 1-D		
S-5	35°10.621'	-81°0.366'	Continuous	0.0023 timed-volumetric				
S-6	35°10.626'	-81°0.369'	Continuous	0.0002 timed-volumetric				
S-7	35°10.664'	-81°0.380'	Continuous	0.0002 timed-volumetric		Concentrated Flow in 12' CMP 1-D		
S-8	35°10.706'	-81°0.391'	Continuous	0.0002 timed-volumetric				
S-9	35°11.146'	-81°0.394'	Continuous	0.0002 timed-volumetric				

- LEGEND:**
- DUKE ENERGY PROPERTY BOUNDARY
  - ASH BASIN WASTE BOUNDARY
  - ASH STORAGE AREA BOUNDARY
  - ASH BASIN COMPLIANCE BOUNDARY
  - - - ASH BASIN COMPLIANCE BOUNDARY COINCIDENT WITH DUKE PROPERTY BOUNDARY
  - - - STREAM
  - - - TOPOGRAPHIC CONTOUR (4-FT INTERVAL)
  - ASH BASIN COMPLIANCE GROUNDWATER MONITORING WELL
  - SEEP SAMPLE LOCATION
  - NPDES OUTFALL LOCATION
  - 1-D DISCHARGE SAMPLING LOCATIONS
  - 1-B BACKGROUND SAMPLING LOCATIONS

**NOTES:**

1. PARCEL DATA FOR THE SITE WAS OBTAINED FROM DUKE ENERGY REAL ESTATE AND IS APPROXIMATE.
2. WASTE BOUNDARY IS APPROXIMATE.
3. AS-BUILT MONITORING WELL LOCATIONS PROVIDED BY DUKE ENERGY AND WSP.
4. TOPOGRAPHY DATA FOR THE SITE WAS OBTAINED FROM NC DOT GEOGRAPHIC INFORMATION SYSTEM (GIS) WEB SITE (DATED 2007).
5. AERIAL PHOTOGRAPHY WAS OBTAINED FROM WSP DATED APRIL 17, 2014.
6. THE COMPLIANCE BOUNDARY IS ESTABLISHED ACCORDING TO THE DEFINITION FOUND IN 15A NCAC 02L .0107 (a).
7. SEEP SAMPLING LOCATIONS ARE APPROXIMATE.
8. NPDES OUTFALL LOCATIONS PROVIDED BY DUKE ENERGY.
9. SEE REPORT "ALLEN STEAM STATION ASH BASIN SURFACE WATER AND SEEP MONITORING - OCTOBER 2014, APPENDIX C" FOR DESCRIPTION OF DAM DRAINAGE SYSTEM.



**TOPOGRAPHIC MAP WITH IDENTIFIED SEEPS AND OUTFALLS**  
 DUKE ENERGY CAROLINAS, LLC  
 ALLEN STEAM STATION ASH BASIN  
 NPDES PERMIT #NC0004979  
 GASTON COUNTY, NORTH CAROLINA

DATE  
 DECEMBER 2014  
 FIGURE  
 2

**Table 1 – Allen Steam Station Ash Basin –Seep and Associated Discharge Locations and Descriptions**

Seep / Discharge ID	Location Coordinates (NAD 83)		Flow Description	Flow Measurement (MGD) and Method	Background Locations	Discharge Location	Discharge Location Coordinates (NAD 83)	
	Latitude	Longitude					Latitude	Longitude
S-1	35°10.242'	-81°0.625'	Continuous	0.0004 timed-volumetric	1-B	Tributary towards Lake Wylie 1-D	35°10.451'	-81°0.325'
S-2	35°10.426'	-81°0.344'	Continuous	0.0025 timed-volumetric				
S-3	35°10.513'	-81°0.360'	Continuous	0.0083 timed-volumetric				
S-4	35°10.513'	-81°0.360'	Continuous	0.0008 timed-volumetric				
S-5	35°10.621'	-81°0.366'	Continuous	0.0023 timed-volumetric		Unconfined diffuse flow towards Lake Wylie 1-D		
S-6	35°10.626'	-81°0.369'	Continuous	0.0002 timed-volumetric				
S-7	35°10.664'	-81°0.380'	Continuous	0.0002 timed-volumetric				
S-8	35°10.706'	-81°0.391'	Continuous	0.0002 timed-volumetric		Concentrated Flow in 12' CMP 1-D		
S-9	35°11.146'	-81°0.394'	Continuous	0.0002 timed-volumetric				

Notes:

1. Flow description for each seep sample location is based on observation during site visits performed by HDR on August 21, 2014
2. Flow measurements and analytical samples were collected on September 4 and September 9, 2014
3. Location coordinates (degrees) for seep sampling locations are approximate and are in NAD 83 datum

**Table 2 – Laboratory Analytical Methods**

<b>Parameter</b>	<b>Method</b>	<b>Reporting Limit</b>	<b>Units</b>	<b>Laboratory</b>
<b>Fluoride (F)</b>	EPA 300.0	1	mg/l	Duke Energy
<b>Mercury (Hg)</b>	EPA 245.1	0.05	µg/l	Duke Energy
<b>Arsenic (As)</b>	EPA 200.8	1	µg/l	Duke Energy
<b>Cadmium (Cd)</b>	EPA 200.8	1	µg/l	Duke Energy
<b>Chromium (Cr)</b>	EPA 200.8	1	µg/l	Duke Energy
<b>Copper (Cu)</b>	EPA 200.8	1	µg/l	Duke Energy
<b>Lead (Pb)</b>	EPA 200.8	1	µg/l	Duke Energy
<b>Nickel (Ni)</b>	EPA 200.8	1	µg/l	Duke Energy
<b>Selenium (Se)</b>	EPA 200.8	1	µg/l	Duke Energy

**Table 3 – Allen Steam Station – Example of Surface Water/Seep Monitoring Flow and Analysis Results Table**

Parameter	Units	S-1	S-2	S-3	S-4	S-5	S-6	S-7	S-8	S-9	Lake Wylie- Upstream	Lake Wylie- Downstream
Fluoride	mg/l	0.11	0.1	0.13	<0.1	<0.1	0.11	<0.1	0.17	<0.5	N/A	N/A
Hg - Mercury (71900)	µg/l	<1	<1	<1	<1	<1	<1	<1	<1	<1	<1	<1
As - Arsenic (01002)	µg/l	<1	<1	<1	<1	<1	<1	<1	<1	<1	<1	<1
Cd - Cadmium (01027)	µg/l	<1	<1	<1	<1	<1	<1	<1	<1	<1	<1	<1
Cr - Chromium (01034)	µg/l	1.42	<1	<1	<1	<1	<1	<1	<1	<1	<1	<1
Cu - Copper (01042)	µg/l	<1	<1	<1	<1	<1	1.14	<1	<1	1.31	2.80	2.60
Pb - Lead (01051)	µg/l	<1	<1	<1	<1	<1	<1	<1	<1	<1	<1	<1
Ni - Nickel (01067)	µg/l	<1	1.58	<1	<1	8.23	2.29	<1	<1	2.78	N/A	N/A
Se - Selenium (01147)	µg/l	<1	<1	<1	<1	<1	<1	<1	<1	<1	<1	<1
pH	s.u.	6.63	6.33	6.95	6.92	5.56	4.67	5.64	8.11	7.52	N/A	N/A
Temperature	°C	23.8	20.9	21.5	21.6	17.6	17.6	20.4	23.6	19	N/A	N/A
Flow	MGD	0.0004	0.0025	0.0083	0.0008	0.0023	0.0002	0.0002	0.0002	0.0002	N/A	N/A

Notes:

1. Flow measurements and analytical samples were collected on September 4 and 9, 2014
2. N/A indicates not applicable
3. Lake Wylie samples were collected on August 27, 2014